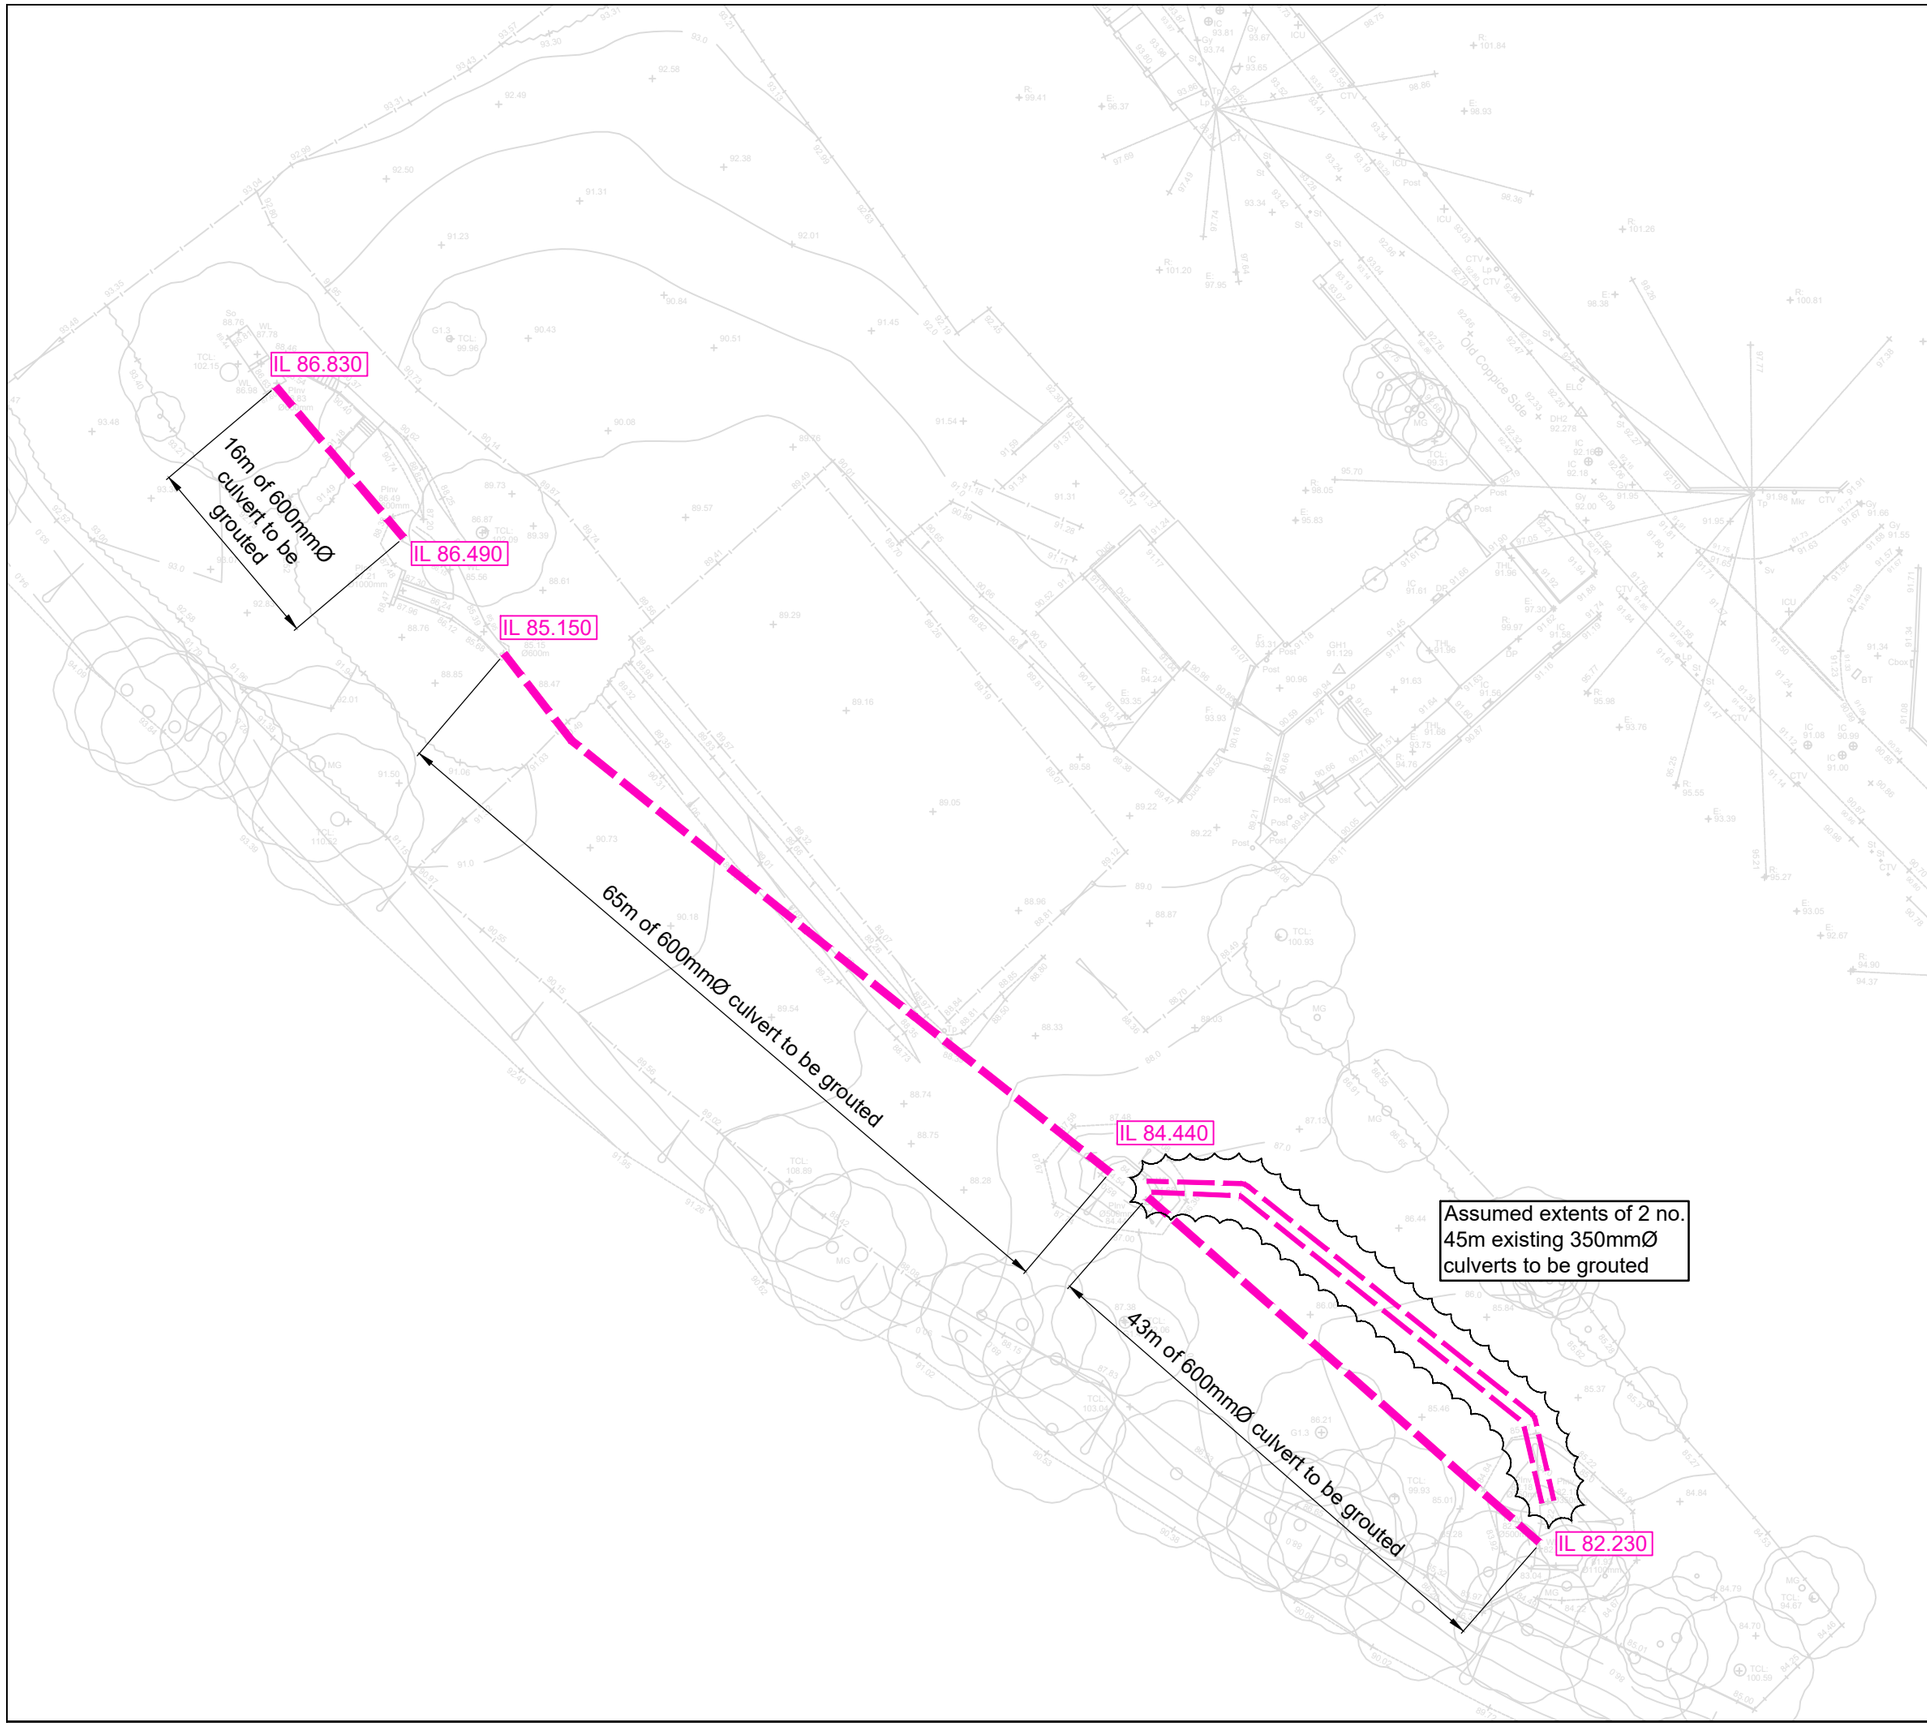


General Notes

1. Where pipelines are to be abandoned and filled by grouting, the lowest point of the abandoned length shall be suitably sealed, and the filling operation shall commence from that point and continue progressively so as to fill all voids completely.

2. Grouting pipes shall be inserted in the line of the pipeline at intervals not exceeding 25 m. The pipelines shall be solidly filled with grout (Class G3 or G4) and the grouting pipes cut off on completion of the filling. Care shall be taken to avoid impregnation of the bedding material around the main pipeline.

3. All works to be in accordance with the "Civil Engineering Specification for the Water Industry."

REV	BY	DATE	DETAILS	CKD

STATUS: Tender

CLIENT

EMH

PROJECT

Old Coppice Side
Heanor

TITLE

Extents of Culvert Grouting Required

hsp consulting
Lawrence House, 4 Meadowbank Way, Eastwood, Nottingham, NG16 3SB
Tel: 01773 535555
www.hspconsulting.com

SCALE	SHEET SIZE	
1:500	A3	
DATE	DRAWN	CHECKED
16.09.21	SA	EMH
PROJECT NO.	DRAWING NO.	REV
C2976	SK001	P01