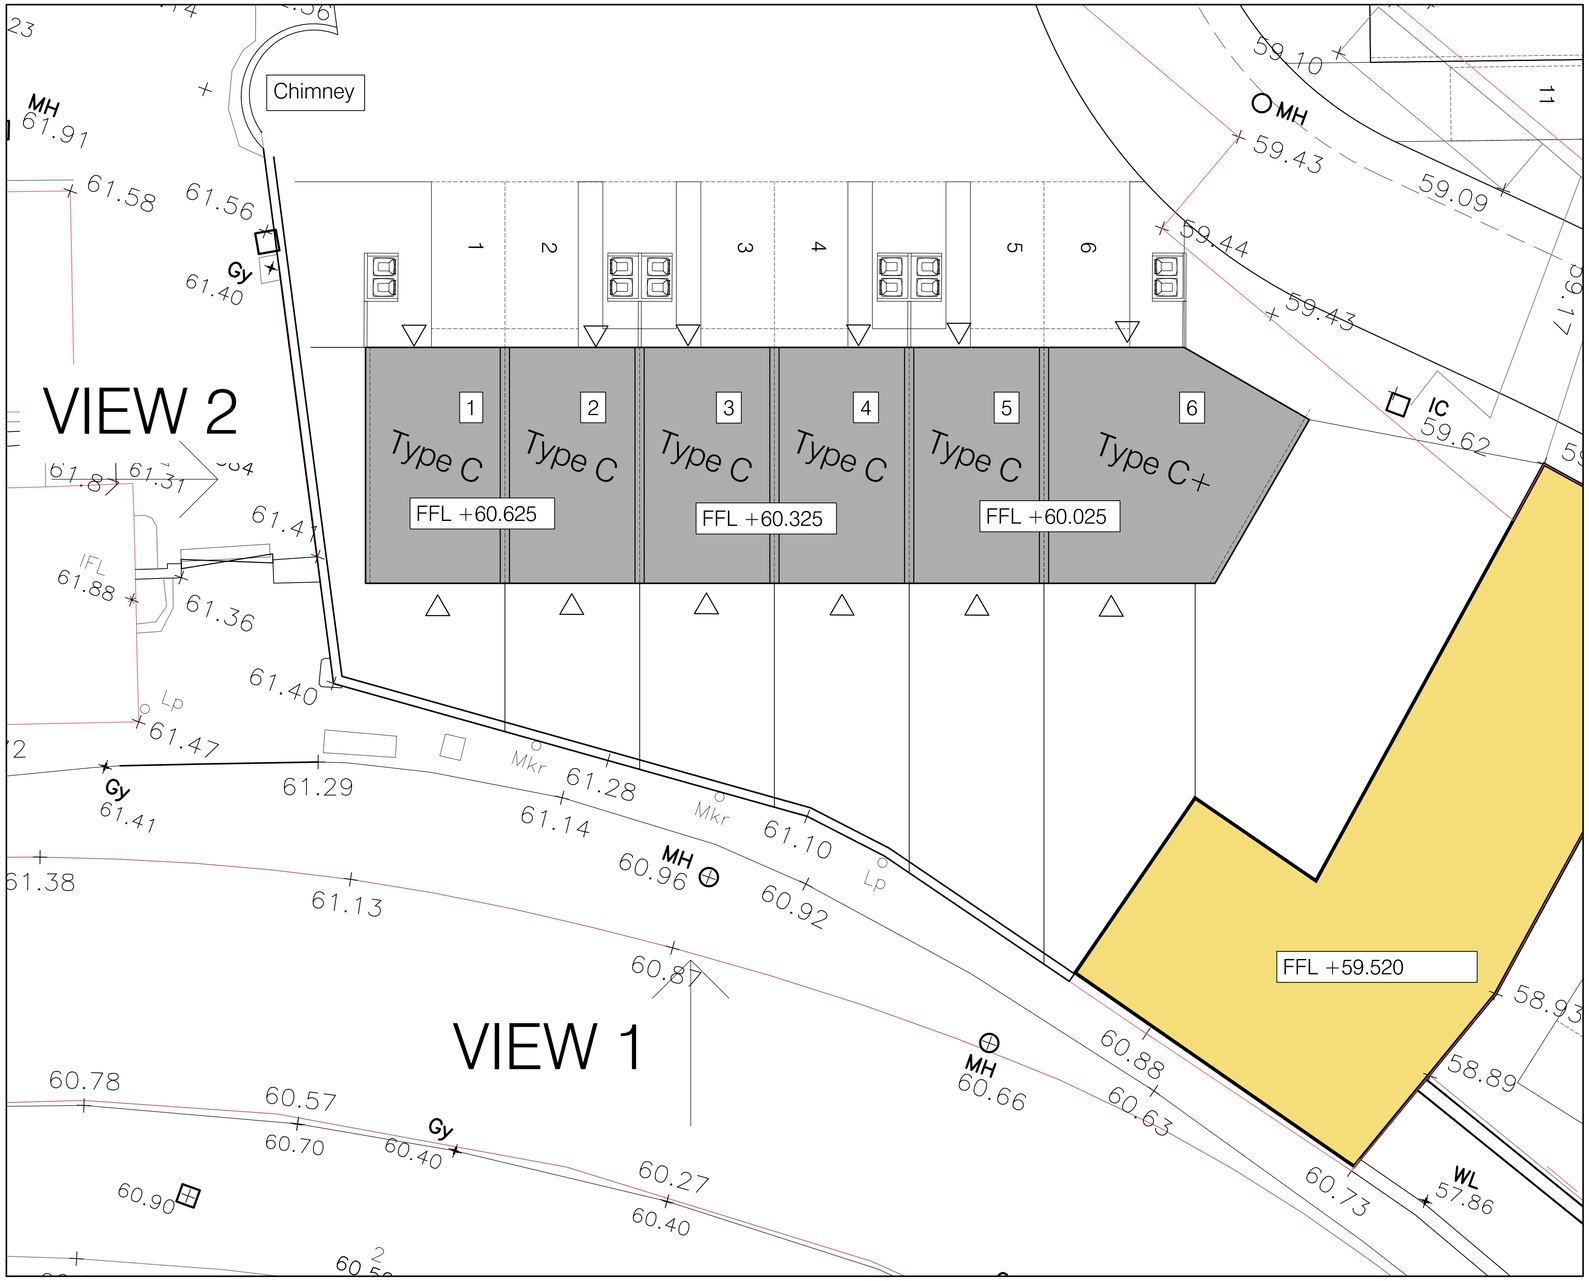

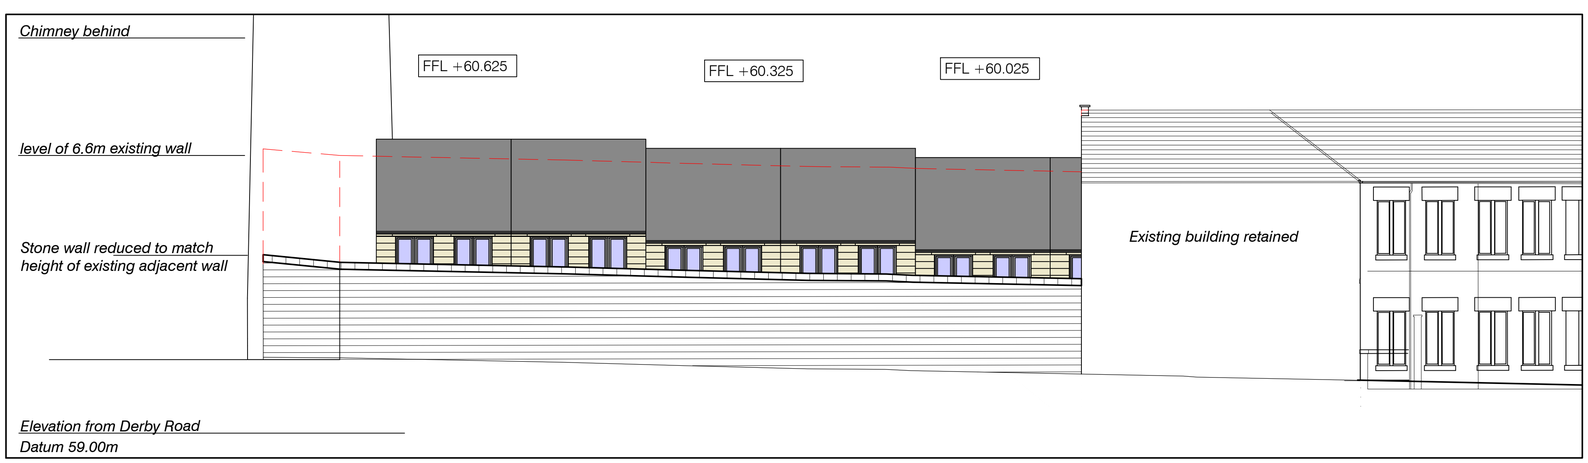

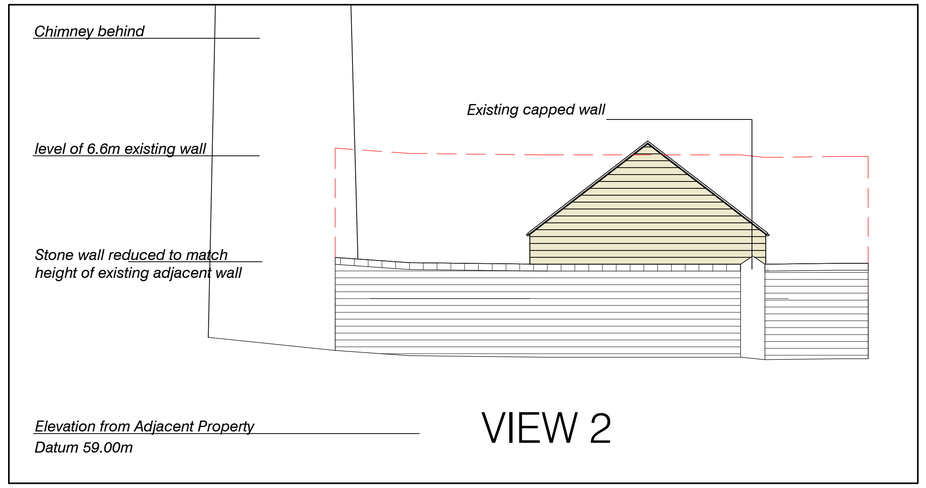

LIME MORTAR SPECIFICATION:
NATURAL HYDRAULIC LIME
Existing lime mortar to be void tested to BS 812-2,1995
Non hydraulic lime mortar to match existing generally to comprise of fine aggregate sand to BS EN 13139 1995
washed sharp sand to be nominally 5mm to 75 microns
Max aggregate size to be no more 1 / 3 joint width.
Lime mortar to BS EN 459-1,2015
Dry mix two parts sand (on soft / one sharp) to one part lime.
Water to be added to achieve smooth malleable consistancy,
Nom 4 litres / 25Kg.

Heritage NHL mortar, NHL 3.5 to approved colour.
Supplied by The Lime Centre.
www.thelimecentre.co.uk, Tel 01962713636

0 5 10
SCALE 1:100 (A1) METRES

rev.	date		drawn	chk'd
A	21.07.22	NHL mortar spec. added	PJS	GSA

Gould Singleton Architects
Tel: 0121 550 0359 Fax: 0121 550 8088
e-mail: info@gould-singleton.co.uk

scales: 1:100@A1
date: 12.2021
drawn: TS checked: GSA
number: 22-1908-005a

Milford Mill
Derby Road
Milford

Street view from Derby Road

This drawing and the building works depicted are the copyright of the Architects and may not be reproduced except by written permission. This drawing must be read and checked against any specialist drawings and information provided. Do not scale prints. Figured dimensions only to be taken from this drawing.